

November 5, 2021

Mr. David Micek
Supervisor of Buildings and Grounds
Falconer Central School District
2 East Avenue North
Falconer, New York 14733

RE: Lead Testing in School Drinking Water

Dear Mr. Micek:

This letter is provided by Stohl Environmental LLC and includes results of Lead Testing in School Drinking Water for the following educational building(s):

- Falconer Middle/High School – 2 East Avenue, Falconer, NY 14733

This letter is prepared to assist the District in complying with the requirements of NYS regulations, *SUBPART 67-4: Lead Testing in School Drinking Water*, by identifying the sources of potable water with lead concentrations greater than the NYS “Action Level of 15 parts per billion (ppb)”.

The collection of water samples was performed by School District staff on June 30, 2021 following the requirements of NYS regulations as well as USEPA Technical Guidance Document “3-T’s for Reducing Lead in Drinking Water in Schools”. The water samples were then delivered by the School District to Stohl Environmental following strict chain-of-custody protocols. Once received, the water samples were then transmitted by Stohl Environmental to an independent laboratory approved by the NYS Department of Health’s Environmental Laboratory Approval Program (ELAP) following strict chain-of-custody protocols.

As detailed below, based on the laboratory results, 6 sources of potable water the Falconer Middle/High have been identified as having lead concentrations in water above the NYS Action Level of 15 parts per billion. Additionally, 12 samples were not received by the lab and were not analyzed. These Location should be resampled and analyzed at a later date. To comply with NYS regulations, Response actions are required by the District as identified below.

Laboratory reports and Chain of Custody forms are included as attachments to this letter.
Thank you for the opportunity to be of service to Falconer School District

Sincerely,
Stohl Environmental, LLC.



Eric Henderson Jr.
Senior Project Manager

Summary of Sampling and Analysis

Total Number of Samples Collected by Building Classified by First Draw:

Building Name	Date of Sample Event	Total Number Samples Collected	First Draw Samples	
			Number of Samples Below Action level of 15 ppb	Number of Samples Above Action Level of 15 ppb
Middle/High School	6/30/2021	44	38	6

Listing of Outlets Requiring Remediation

Locations of Outlets Analyzed above the NYS Action Level of 15 parts per billion based upon Analysis of First Draw Samples:

Sample #	Classroom or other Location	Fixture/Outlet type	Laboratory Analysis in ppb
MH-7	Hall 346 Fountain	Drinking Fountain	N/A
MH-8	351N	Sink	116
MH-9	351S	Sink	44.0
MH-19	Hall 250 Fountain	Drinking Fountain	15.5
MH-35	Hall 160 Fountain	Sink	18.6
MH-36	165	Sink	97.4
MH-37	Hall 165 Fountain	Sink	78.7
MH-48	110W	Sink	N/A
MH-49	110E	Sink	N/A
MH-50	208W	Sink	N/A
MH-51	208C	Sink	N/A
MH-52	208E	Sink	N/A
MH-53	308W	Sink	N/A
MH-54	308E	Sink	N/A
MH-55	312	Sink	N/A
MH-56	309	Sink	N/A
MH-57	209	Sink	N/A
MH-58	109	Sink	N/A

N/A = Not Analyzed. The laboratory received the sample empty and was not able to be analyzed. Location should be resampled and analyzed at a later date.

1.3 Response Actions Required Under NYS Regulations, Section 67-4.4:

For outlets analyzed with a lead concentration in excess of the NYS Action Level, regulations require:

- (a) Prohibit use of the outlet until:
 - (1) a lead remediation plan is implemented to mitigate the lead level of such outlet; and
 - (2) test results indicate that the lead levels are at or below the action level;
- (b) provide building occupants with an adequate supply of potable water for drinking and cooking until remediation is performed;
- (c) report the test results to the local health department as soon as practicable, but no more than 1 business day after the school received the laboratory report; and
- (d) notify all staff and all persons in parental relation to students of the test results, in writing, as soon as practicable but no more than 10 business days after the school received the laboratory report.

Laboratory Analytical Reports

CERTIFICATE OF ANALYSIS

Client: Stohl Environmental
3860 California Road
Orchard Park NY 14127

Client: STO708

Report Date: 8/26/2021
Report No.: 642986 - Lead Water
Project: Falconer Middle/High School
Project No.: 2020L-146.3

LEAD WATER SAMPLE ANALYSIS SUMMARY

Lab No.: 7276151 Location: 232 Result(ppb): <1.00
Client No.: MH-1A * Sample acidified to pH <2.

Lab No.: 7276152 Location: 232 Result(ppb): <1.00
Client No.: MH-1B * Sample acidified to pH <2.

Lab No.: 7276153 Location: Hall 102 FNTN Result(ppb): <1.00
Client No.: MH-2 * Sample acidified to pH <2.

Lab No.: 7276154 Location: Hall 202 FNTN Result(ppb): 2.20
Client No.: MH-3 * Sample acidified to pH <2.

Lab No.: 7276155 Location: Hall 302 FNTN Result(ppb): <1.00
Client No.: MH-4 * Sample acidified to pH <2.

Lab No.: 7276156 Location: Hall 325 FNTN Result(ppb): <1.00
Client No.: MH-5 * Sample acidified to pH <2.


Lab No.: 7276157 Location: Hall 346 FNTN Result(ppb): Sample Not Received
Client No.: MH-7 * Sample acidified to pH <2.


Lab No.: 7276158 Location: 351N Result(ppb): 116
Client No.: MH-8 * Sample acidified to pH <2.

Lab No.: 7276159 Location: 351S Result(ppb): 44.0
Client No.: MH-9 * Sample acidified to pH <2.

Lab No.: 7276160 Location: Hall 356 FNTN Result(ppb): 3.60
Client No.: MH-10 * Sample acidified to pH <2.

Please refer to the Appendix of this report for further information regarding your analysis.

Date Received: 8/19/2021
Date Analyzed: 08/25/2021
Signature: 
Analyst: Chad Shaffer

Approved By: 
Frank E. Ehrenfeld, III
Laboratory Director

CERTIFICATE OF ANALYSIS

Client: Stohl Environmental
3860 California Road
Orchard Park NY 14127


Client: STO708


Report Date: 8/26/2021
Report No.: 642986 - Lead Water
Project: Falconer Middle/High School
Project No.: 2020L-146.3

LEAD WATER SAMPLE ANALYSIS SUMMARY

Lab No.: 7276161 Client No.: MH-11	Location: Hall 281 FNTN * Sample acidified to pH <2.	Result(ppb): 1.50
<hr/>		
Lab No.: 7276162 Client No.: MH-12	Location: 275 * Sample acidified to pH <2.	Result(ppb): <1.00
<hr/>		
Lab No.: 7276163 Client No.: MH-13	Location: Hall 271 FNTN * Sample acidified to pH <2.	Result(ppb): <1.00
<hr/>		
Lab No.: 7276164 Client No.: MH-14	Location: Cafe * Sample acidified to pH <2.	Result(ppb): <1.00
<hr/>		
Lab No.: 7276165 Client No.: MH-15	Location: Kitchen S * Sample acidified to pH <2.	Result(ppb): 2.80
<hr/>		
Lab No.: 7276166 Client No.: MH-17	Location: Kitchen W * Sample acidified to pH <2.	Result(ppb): 1.70
<hr/>		
Lab No.: 7276167 Client No.: MH-18	Location: Hall 267 FNTN * Sample acidified to pH <2.	Result(ppb): <1.00

Please refer to the Appendix of this report for further information regarding your analysis.

Date Received: 8/19/2021
Date Analyzed: 08/25/2021
Signature: 
Analyst: Chad Shaffer

Approved By: 
Frank E. Ehrenfeld, III
Laboratory Director

CERTIFICATE OF ANALYSIS

Client: Stohl Environmental
3860 California Road
Orchard Park NY 14127


Client: STO708


Report Date: 8/26/2021
Report No.: 642986 - Lead Water
Project: Falconer Middle/High School
Project No.: 2020L-146.3

LEAD WATER SAMPLE ANALYSIS SUMMARY

Lab No.: 7276168 Client No.: MH-19	Location: Hall 250 FNTN * Sample acidified to pH <2.	Result(ppb): 15.5
Lab No.: 7276169 Client No.: MH-20	Location: 240 * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7276170 Client No.: MH-21	Location: 239 * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7276171 Client No.: MH-22	Location: 237 * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7276172 Client No.: MH-23	Location: 254E * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7276173 Client No.: MH-24	Location: 254NE * Sample acidified to pH <2.	Result(ppb): 1.30
Lab No.: 7276174 Client No.: MH-25	Location: 254NW * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7276175 Client No.: MH-26	Location: 254W * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7276176 Client No.: MH-27	Location: 254CTR * Sample acidified to pH <2.	Result(ppb): 1.40
Lab No.: 7276177 Client No.: MH-28	Location: 255 * Sample acidified to pH <2.	Result(ppb): <1.00

Please refer to the Appendix of this report for further information regarding your analysis.

Date Received: 8/19/2021
Date Analyzed: 08/26/2021
Signature: 
Analyst: Chad Shaffer

Approved By: 
Frank E. Ehrenfeld, III
Laboratory Director

CERTIFICATE OF ANALYSIS

Client: Stohl Environmental
3860 California Road
Orchard Park NY 14127


Client: STO708


Report Date: 8/26/2021
Report No.: 642986 - Lead Water
Project: Falconer Middle/High School
Project No.: 2020L-146.3

LEAD WATER SAMPLE ANALYSIS SUMMARY

Lab No.:7276178 Client No.:MH-29	Location:257E * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7276179 Client No.:MH-30	Location:257CTR * Sample acidified to pH <2.	Result(ppb):1.60
Lab No.:7276180 Client No.:MH-31	Location:257W * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7276181 Client No.:MH-32	Location:259E * Sample acidified to pH <2.	Result(ppb):2.50
Lab No.:7276182 Client No.:MH-33	Location:259CTR * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7276183 Client No.:MH-34	Location:259W * Sample acidified to pH <2.	Result(ppb):<1.00
Lab No.:7276184 Client No.:MH-35	Location:Hall 160 FNTN * Sample acidified to pH <2.	Result(ppb):18.6
Lab No.:7276185 Client No.:MH-36	Location:165 * Sample acidified to pH <2.	Result(ppb):97.4
Lab No.:7276186 Client No.:MH-37	Location:Hall 165 FNTN * Sample acidified to pH <2.	Result(ppb):78.7
Lab No.:7276187 Client No.:MH-38	Location:Hall Stair F FNTN * Sample acidified to pH <2.	Result(ppb):<1.00

Please refer to the Appendix of this report for further information regarding your analysis.

Date Received: 8/19/2021
Date Analyzed: 08/26/2021
Signature: 
Analyst: Chad Shaffer

Approved By: 
Frank E. Ehrenfeld, III
Laboratory Director

CERTIFICATE OF ANALYSIS

Client: Stohl Environmental
3860 California Road
Orchard Park NY 14127


Client: STO708


Report Date: 8/26/2021
Report No.: 642986 - Lead Water
Project: Falconer Middle/High School
Project No.: 2020L-146.3

LEAD WATER SAMPLE ANALYSIS SUMMARY

Lab No.: 7276188 Client No.: MH-39	Location: 168 * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7276189 Client No.: MH-40	Location: 173 * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7276190 Client No.: MH-41	Location: 176 * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7276191 Client No.: MH-42	Location: Hall 196 FNTN * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7276192 Client No.: MH-43	Location: Outside BR E * Sample acidified to pH <2.	Result(ppb): 5.20
Lab No.: 7276193 Client No.: MH-44	Location: Outside BR W * Sample acidified to pH <2.	Result(ppb): 11.0
Lab No.: 7276194 Client No.: MH-45	Location: Concession * Sample acidified to pH <2.	Result(ppb): <1.00
Lab No.: 7276195 Client No.: MH-48	Location: 110W * Sample acidified to pH <2.	Result(ppb): Sample Not Received
Lab No.: 7276196 Client No.: MH-49	Location: 110E * Sample acidified to pH <2.	Result(ppb): Sample Not Received
Lab No.: 7276197 Client No.: MH-50	Location: 208W * Sample acidified to pH <2.	Result(ppb): Sample Not Received

Please refer to the Appendix of this report for further information regarding your analysis.

Date Received: 8/19/2021
Date Analyzed: 08/26/2021
Signature: 
Analyst: Chad Shaffer

Approved By: 
Frank E. Ehrenfeld, III
Laboratory Director

CERTIFICATE OF ANALYSIS

Client: Stohl Environmental
3860 California Road
Orchard Park NY 14127


Client: STO708


Report Date: 8/26/2021
Report No.: 642986 - Lead Water
Project: Falconer Middle/High School
Project No.: 2020L-146.3

LEAD WATER SAMPLE ANALYSIS SUMMARY

Lab No.: 7276198 Client No.: MH-52	Location: 208C * Sample acidified to pH <2.	Result(ppb): Sample Not Received
Lab No.: 7276199 Client No.: MH-52	Location: 208E * Sample acidified to pH <2.	Result(ppb): Sample Not Received
Lab No.: 7276200 Client No.: MH-53	Location: 308W * Sample acidified to pH <2.	Result(ppb): Sample Not Received
Lab No.: 7276201 Client No.: MH-54	Location: 308E * Sample acidified to pH <2.	Result(ppb): Sample Not Received
Lab No.: 7276202 Client No.: MH-55	Location: 312 * Sample acidified to pH <2.	Result(ppb): Sample Not Received
Lab No.: 7276203 Client No.: MH-56	Location: 309 * Sample acidified to pH <2.	Result(ppb): Sample Not Received
Lab No.: 7276204 Client No.: MH-57	Location: 209 * Sample acidified to pH <2.	Result(ppb): Sample Not Received
Lab No.: 7276205 Client No.: MH-58	Location: 109 * Sample acidified to pH <2.	Result(ppb): Sample Not Received
Lab No.: 7276206 Client No.: MH-16	Location: Additional Sample Received * Sample acidified to pH <2.	Result(ppb): 1.50

Please refer to the Appendix of this report for further information regarding your analysis.

Date Received: 8/19/2021
Date Analyzed: 08/26/2021
Signature: 
Analyst: Chad Shaffer

Approved By: 
Frank E. Ehrenfeld, III
Laboratory Director

CERTIFICATE OF ANALYSIS

Client: Stohl Environmental
3860 California Road
Orchard Park NY 14127

Client: STO708

Report Date: 8/26/2021
Report No.: 642986 - Lead Water
Project: Falconer Middle/High School
Project No.: 2020L-146.3

Appendix to Analytical Report:

Customer Contact: Lab Results Final
Analysis: AAS-GF - ASTM D3559-08D

This appendix seeks to promote greater understanding of any observations, exceptions, special instructions, or circumstances that the laboratory needs to communicate to the client concerning the above samples. The information below is used to help promote your ability to make the most informed decisions for you and your customers. Please note the following points of contact for any questions you may have.

iATL Customer Service: customerservice@iatl.com
iATL Office Manager: ?wchampion@iatl.com
iATL Account Representative: Shirley Clark
Sample Login Notes: See Batch Sheet Attached
Sample Matrix: Water
Exceptions Noted: See Following Pages

General Terms, Warrants, Limits, Qualifiers:

General information about iATL capabilities and client/laboratory relationships and responsibilities are spelled out in iATL policies that are listed at www.iATL.com and in our Quality Assurance Manual per ISO 17025 standard requirements. The information therein is a representation of iATL definitions and policies for turnaround times, sample submittal, collection media, blank definitions, quantification issues and limit of detection, analytical methods and procedures, sub-contracting policies, results reporting options, fees, terms, and discounts, confidentiality, sample archival and disposal, and data interpretation.

iATL warrants the test results to be of a precision normal for the type and methodology employed for each sample submitted. iATL disclaims any other warrants, expressed or implied, including warranty of fitness for a particular purpose and warranty of merchantability. iATL accepts no legal responsibility for the purpose for which the client uses test results. Any analytical work performed must be governed by our Standard Terms and Conditions. Prices, methods and detection limits may be changed without notification. Please contact your Customer Service Representative for the most current information.

This confidential report relates only to those item(s) tested and does not represent an endorsement by NIST-NVLAP, AIHA LAP LLC, or any agency of local, state or province governments nor of any agency of the U.S. government.

This report shall not be reproduced except in full, without written approval of the laboratory.

Information Pertinent to this Report:

Analysis by AAS Graphite Furnace:

- ASTM D3559-08D

Certification:

- NYS-DOH No. 11021

- NJDEP No. 03863

Note: These methods are analytically equivalent to iATL's accredited method;

- USEPA 40CFR 141.11B

- USEPA 200.9 Pb, AAS-GF, RL <2 ppb/sample

- USEPA SW 846-7421 - Pb(AAS-GF, RL <2 ppb/sample)

Regulatory limit for lead in drinking water is 15.0 parts per billion as cited in EPA 40 CFR 141.11 National Primary Drinking Water Regulations, Subpart B: Maximum contaminant levels for inorganic chemicals.

All results are based on the samples as received at the lab. iATL assumes that appropriate sampling methods have been used and that the data upon which these results are based have been accurately supplied by the client.

Sample results are not corrected for contamination by field or analytical blanks.

PPB = Parts per billion. 1 µg/L = 1 ppb MDL = 0.24 PPB Reporting Limit (RL) = 1.0 PPB

CERTIFICATE OF ANALYSIS

Client: Stohl Environmental
3860 California Road
Orchard Park NY 14127

Client: STO708

Report Date: 8/26/2021
Report No.: 642986 - Lead Water
Project: Falconer Middle/High School
Project No.: 2020L-146.3

Disclaimers / Qualifiers:

There may be some samples in this project that have a "NOTE:" associated with a sample result. We use added disclaimers or qualifiers to inform the client about something that requires further explanation. Here is a complete list with highlighted disclaimers pertinent to this project. For a full explanation of these and other disclaimers, please inquire at customerservice@iatl.com.

Matrix spiking is performed on each client batch to determine if interferences could impact results. When spike recoveries fall out of acceptable range matrix interference is suspected and samples are diluted until acceptable spike recovery can be achieved. Reporting limits will increase by the same degree as the dilution required.

Note: Sample dilution required due to matrix interference.

Water Sample Turbidity greater than 1.0 NTU does not meet Federal and NJ State Primary & Secondary Drinking Water Standards.

* ASTM D3559 (D) calls for the addition of acid at the time of sampling. Unless so noted on the chain of custody by the client iATL acidifies samples to a pH of <2 at least 24 hours prior to analysis.

Laboratory Certifications

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2022
Issued April 01, 2021

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MR. FRANK E. EHRENFELD III
INTERNATIONAL ASBESTOS TESTING LABS
9000 COMMERCE PARKWAY SUITE B
MOUNT LAUREL, NJ 08054

NY Lab Id No. 11021

is hereby APPROVED as an Environmental Laboratory for the category
ENVIRONMENTAL ANALYSES-POTABLE WATER
All approved subcategories and/or analytes are listed below:

Metals I

Lead, Total

ASTM D3559-90, 96, 03 & 08 (D)

Miscellaneous

Asbestos

EPA 100.1

EPA 100.2

New York
State
Department of Health

Department
of Health

Serial No.: 62872

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.

Chains of Custody

4
Lead Testing in Water
Falconer Middle/High School

According to Public Health Law
sections 1370-a and 1110, Subpart 67-4 of Title 10 (Health)
of the Official Compilation of Codes, Rules and Regulations
of the State of New York

RECEIVED

AUG 19 2021

iATL - By

C8/26/21 Test

Sample Location	Sample Identification	Draw Date	Draw Time
232	MH-1A	06/30/21 7276151	7:30 AM
232	MH-1B	06/30/21 7276152	7:30 AM
Hall 102 FNTN	MH-2	06/30/21 7276153	7:30 AM
Hall 202 FNTN	MH-3	06/30/21 7276154	7:30 AM
Hall 302 FNTN	MH-4	06/30/21 7276155	7:30 AM
Hall 325 FNTN	MH-5	06/30/21 7276156	7:35 AM
* Hall 346 FNTN	MH-7	06/30/21 7276157	7:35 AM
351N	MH-8	06/30/21 7276158	7:35 AM
351S	MH-9	06/30/21 7276159	7:35 AM
Hall 356 FNTN	MH-10	06/30/21 7276160	7:40 AM
Hall 281 FNTN	MH-11	06/30/21 7276161	7:40 AM
275	MH-12	06/30/21 7276162	7:40 AM
Hall 271 FNTN	MH-13	06/30/21 7276163	7:40 AM
Café	MH-14	06/30/21 7276164	7:40 AM
Kitchen S	MH-15	06/30/21 7276165	7:40 AM
Kitchen W	MH-17	06/30/21 7276166	7:40 AM
Hall 267 FNTN	MH-18	06/30/21 7276167	7:45 AM
Hall 250 FNTN	MH-19	06/30/21 7276168	7:45 AM
240	MH-20	06/30/21 7276169	7:45 AM
239	MH-21	06/30/21 7276170	7:45 AM
237	MH-22	06/30/21 7276171	7:45 AM
254E	MH-23	06/30/21 7276172	7:50 AM
254NE	MH-24	06/30/21 7276173	7:50 AM
254NW	MH-25	06/30/21 7276174	7:50 AM
254W	MH-26	06/30/21 7276175	7:50 AM
254CTR	MH-27	06/30/21 7276176	7:50 AM
255	MH-28	06/30/21 7276177	7:50 AM
257E	MH-29	06/30/21 7276178	7:55 AM
257CTR	MH-30	06/30/21 7276179	7:55 AM
257W	MH-31	06/30/21 7276180	7:55 AM
259E	MH-32	06/30/21 7276181	7:55 AM
259CTR	MH-33	06/30/21 7276182	7:55 AM
259W	MH-34	06/30/21 7276183	7:55 AM
Hall 160 FNTN	MH-35	06/30/21 7276184	8:00 AM
165	MH-36	06/30/21 7276185	8:00 AM

STOHL ENVIRONMENTAL
2020L - 146.3

Lead Testing in Water
Falconer Middle/High School

According to Public Health Law
sections 1370-a and 1110, Subpart 67-4 of Title 10 (Health)
of the Official Compilation of Codes, Rules and Regulations
of the State of New York

Sample Location	Sample Identification	Test Draw Date	Test Draw Time
Hall 165 FNTN	MH-37	06/30/21 7276136	8:00 AM
Hall Stair F FNTN	MH-38	06/30/21 7276137	8:00 AM
168	MH-39	06/30/21 7276138	8:00 AM
173	MH-40	06/30/21 7276139	8:05 AM
176	MH-41	06/30/21 7276140	8:05 AM
Hall 196 FNTN	MH-42	06/30/21 7276141	8:10 AM
Outside BR E	MH-43	06/30/21 7276142	8:10 AM
Outside BR W	MH-44	06/30/21 7276143	8:10 AM
Concession	MH-45	06/30/21 7276144	8:15 AM
Hydrant N	MH-46	Removed	
Hydrant S	MH-47	Removed	
110W	MH-48	06/30/21 7276145	8:20 AM
110E	MH-49	06/30/21 7276146	8:20 AM
208W	MH-50	06/30/21 7276147	8:20 AM
208C	MH-51	06/30/21 7276148	8:20 AM
208E	MH-52	06/30/21 7276149	8:20 AM
308W	MH-53	06/30/21 7276200	8:25 AM
308E	MH-54	06/30/21 7276201	8:25 AM
312	MH-55	06/30/21 7276202	8:25 AM
309	MH-56	06/30/21 7276203	8:25 AM
209	MH-57	06/30/21 7276204	8:25 AM
109	MH-58	06/30/21 7276205	8:25 AM

ASR

MH-16

7276206

Acidified MS
8/23/21 18:00

*SNR

iATL 7276195

iATL 7276199

iATL 7276203

iATL 7276196

iATL 7276200

iATL 7276204

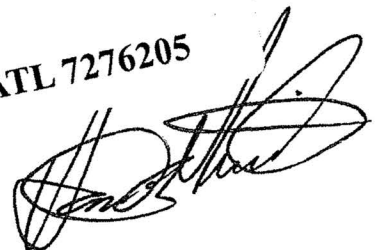
iATL 7276197

iATL 7276201

iATL 7276205

iATL 7276198

iATL 7276202



BLANK

BLANK



3860 California Road, Orchard Park, New York 14127

PHONE (716) 312-0070 FAX (716) 312-8092

WWW.STOHLENVIRONMENTAL.COM